

Automatic phase switch AZF-7

Description

The AZF-7 automatic phase switch is designed to ensure continuous power supply to single-phase loads in installations using two- or three-phase networks, as well as in systems with two or three different voltage sources sharing a common neutral conductor. The device protects loads from unwanted voltage drops and surges in the network. The AZF-7 allows for direct power supply to loads with the following parameters: 5 A 250 V AC AC-1 (0.8 A 250 V AC AC-15).

Principle of operation

The AZF-7 continuously monitors the voltage level on each phase. If the phase supplying the receiver loses its proper parameters (drops below 180 V AC or increases above 260 V AC), the device will automatically switch the receiver to another phase with the correct parameters.

The AZF-7 automatic phase switch operates in L1 phase priority mode. This means that if phase L1 meets the voltage requirements, it will always be selected. **If phase L2 or L3 should have priority in a given installation, you must make the change yourself. That is, connect the selected phase (L2 or L3) to the terminal marked L1 on the AZF-7 .**

Voltage measurement is performed using the TRMS method. The device is resistant to mains frequency fluctuations in the 47-52 Hz range.

LED signaling

Three red LEDs indicate the status of the three-phase network (they do not directly indicate the selected phase). This allows the device to perform an additional function and act as a three-phase modular lamp, providing information about the network status.

The LED lighting configuration indicates the currently selected phase:

- **LEDs L1, L2, L3 are lit** - selected phase: L1 (priority)
- **only the L1, L2 diodes are lit** - selected phase: L1 (priority)
- **only the L1, L3 diodes are lit** - selected phase: L1 (priority)
- **only the L2 and L3 diodes are lit** - selected phase: L2
- **only the L1 diode lights up** - selected phase: L1
- **only the L2 diode lights up** - selected phase: L2
- **only the L3 diode lights up** - selected phase: L3

Three **LEDs flash simultaneously** when none of the phases have the correct parameters – there will be no voltage at the output because no phase is fed to it.




Technical data

Parameter name	Value
Rated supply voltage	3 x 400 / 230 V AC + N
Operating supply voltages	80 to 270 VAC
Rated power supply frequency	50 Hz
Power supply operating frequency	47 to 52 Hz
Operating temperature range	-20 to 50 °C
Max power consumption	3 VA
Operating mode	Priority power supply from L1
Executive element	Relay
Number of relay outputs	1
Contact arrangement	Voltage output
Maximum load current AC-1	5A / 250V AC
Maximum load current AC-15	0.8 A / 250 V AC
Maximum LED load power	35 W
Measurement of U power supply from 47 to 52 Hz	80 to 270 VAC
Upper threshold U of the power switch L1 L2 L3	260V AC

Parameter name	Value
Lower threshold U of the power switch L1 L2 L3	180V AC
Hysteresis U when switching power supply	10V
Measurement accuracy	±0.5%
U power failure switch delay	< 100 ms
Switch delay "<" / ">" U power supply	< 100 ms
Case	Modular housing (1 DIN module)
Degree of protection	IP20
Installation	TH35 rail
Clamp type	Elevator
Wire stripping length	6.5 mm
Single-wire conductor	0.25 to 2.5 mm ²
Multi-stranded conductor (stranded wire) without ferrule	0.25 to 2.5 mm ²
Stranded wire with square crimp sleeve	0.25 to 2.5 mm ²
Tighten to maximum torque	0.5 Nm

Full technical specifications are available on the website www.pollin.pl/do-pobrania or by scanning the QR code provided in the warranty and guarantee section.

Connection diagram

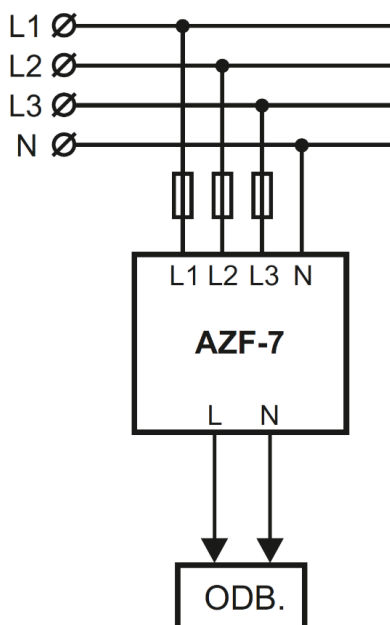

Installation

The AZF-7 automatic phase switch must be installed in accordance with applicable electrical standards and regulations. The following guidelines are intended to ensure the installer's safety and the proper operation of the device:

1. **Authorizations** - The device may only be installed by a person with appropriate qualifications and authorizations to work on electrical installations.
2. **Disconnecting the power supply** - Before starting any work, it is essential to disconnect the power supply at the distribution board and make sure that the circuit is voltage-free (e.g. using a voltage indicator).
3. **Personal Protection** - The installer should use personal protective equipment such as electrically insulating gloves and safety glasses.
4. **Mechanical installation** - The device should be mounted on a standard TH35 rail in the distribution board, ensuring stable mounting and adequate ventilation space.
5. **Connecting Wires** - Connections should be made according to the wiring diagram provided by the manufacturer. Ensure that terminals are tightened with the correct torque and that wires of the appropriate cross-section are used. Only one wire may be inserted into each terminal – regardless of whether it is solid or stranded with a crimped ferrule.
6. **Checking the connections** - After completing the installation, carefully check the correctness of all connections, make sure that the terminals are securely tightened and that there are no exposed wires that could cause a short circuit or a shock hazard.
7. **Restoring Power** - After completing the installation and inspection, turn on the power and check the operation of the device according to the instructions.
8. **Testing** - After installation, verify the correct operation of the device by simulating a phase loss of "L1" and then "L2." In the first case, the AZF-7 should switch the load to phase "L2," and in the second – to phase "L3." A similar response will occur when the voltage on any phase drops below the lower threshold or exceeds the upper threshold. To ensure trouble-free operation of the AZF-7 and avoid overloading the internal relay contacts, 5A overcurrent protection should be installed on the phase inputs.

NOTE: The relays used in the AZF-7 device have a rated current of 5 A for resistive loads (AC-1).

When controlling loads of a different nature, the permissible rated current is significantly reduced:

- Inductive loads (AC-15): (e.g. contactor coils, transformers) – recommended protection and load max. 0.8 A. The electric arc generated during disconnection may lead to rapid burning of the contacts.
- Capacitive and LED loads: (e.g. switched-mode power supplies, LED lighting) – recommended protection and load 0.5 A – 0.8 A. Very high surge currents occurring during switching on may cause permanent welding (gluing) of the relay contacts.

No Modifications - Any modifications to the device or its components are prohibited. This may result in malfunctions and a safety hazard.

Warranty and guarantee – short information

The warranty applies to every purchaser, including consumers. Warranty claims should be directed to the seller from whom the purchase was made.

If a defect is found in the device, the customer has the right to choose: he or she can use the statutory warranty (in accordance with the provisions of the Civil Code) or the manufacturer's warranty.



Pollin Guarantee



Pollin devices are covered by a 10-year manufacturer's warranty – Zakład Elektroniczny POLLIN Wojciech Polak. The warranty applies only to devices purchased by businesses and covers material and manufacturing defects.

Warranty claims should be submitted by e-mail to: pollin@pollin.pl, in accordance with the procedure described in the full version of the document.

The warranty does not cover, among other things, mechanical damage, unauthorized modifications, installation by unqualified persons and natural wear and tear of consumables.

The full text of the warranty terms is available at: <https://pollin.pl/do-pobrania> or via the attached QR code.

Markings



This symbol on a device indicates that the used equipment should not be disposed of with other household waste. Used equipment should be taken to one of the designated electronic waste collection points or returned to the store when purchasing new equipment. Improper disposal of electronic waste poses a threat to the environment and human health.



The CE marking confirms that the product meets the essential requirements of all applicable European Union directives and regulations.



This marking indicates that installation, connection and all servicing of the device may only be performed by qualified personnel with electrical qualifications.

Technical support – the fastest help from Pollin experts

If you have any questions regarding the operation, configuration or installation of the device, **please contact us by email – this is the fastest way to obtain technical support**.

Send a message to: support@pollin.pl, describe the problem in detail and leave your contact number and the hours when we can call you.

Our engineers will review your request and make every effort to provide you with professional assistance as quickly as possible.



Pollin Automation – Technology That Works for You

Want to talk to the sales department?

Use the telephone contact – the number can be found at <https://pollin.pl/>.

Discover the world of Pollin automation – more than one product!

Thank you for your trust and for choosing Pollin technology – solutions that work for you. This is just the beginning of the possibilities Pollin technology offers! Our brand is synonymous with reliability, innovation, and safety in electrical installations.

On the website <https://www.pollin.pl> you will find:

- **A full product catalog** – from automation and security to modern solutions supporting renewable energy sources and Smart Home installations.
- **Downloadable materials** – manuals, diagrams, catalog cards and warranty documents in one place.

Don't wait – scan the QR code from the manual or visit our website and discover solutions that are changing industry standards.

Pollin is more than just a product
It is a trusted partner in your work!